


VR-201-202-XX Healy Quarterly Inspection

SOURCE INFORMATION and Inspection Date:	
Facility (DBA):	Individual conducting inspection:
Facility Street Address:	Affiliation:
City/Zip:	P/O Number:
Valve	<u>Clean Air Separator Inspection</u> Check One Box Below
A	<input type="checkbox"/> Open <input type="checkbox"/> Closed
B	<input type="checkbox"/> Open <input type="checkbox"/> Closed
C	<input type="checkbox"/> Open <input type="checkbox"/> Closed
D	<input type="checkbox"/> Open <input type="checkbox"/> Closed
Plug	
E	<input type="checkbox"/> Installed <input type="checkbox"/> Missing
F	<input type="checkbox"/> Installed <input type="checkbox"/> Missing

Clean Air Separator Normal Operating Configuration



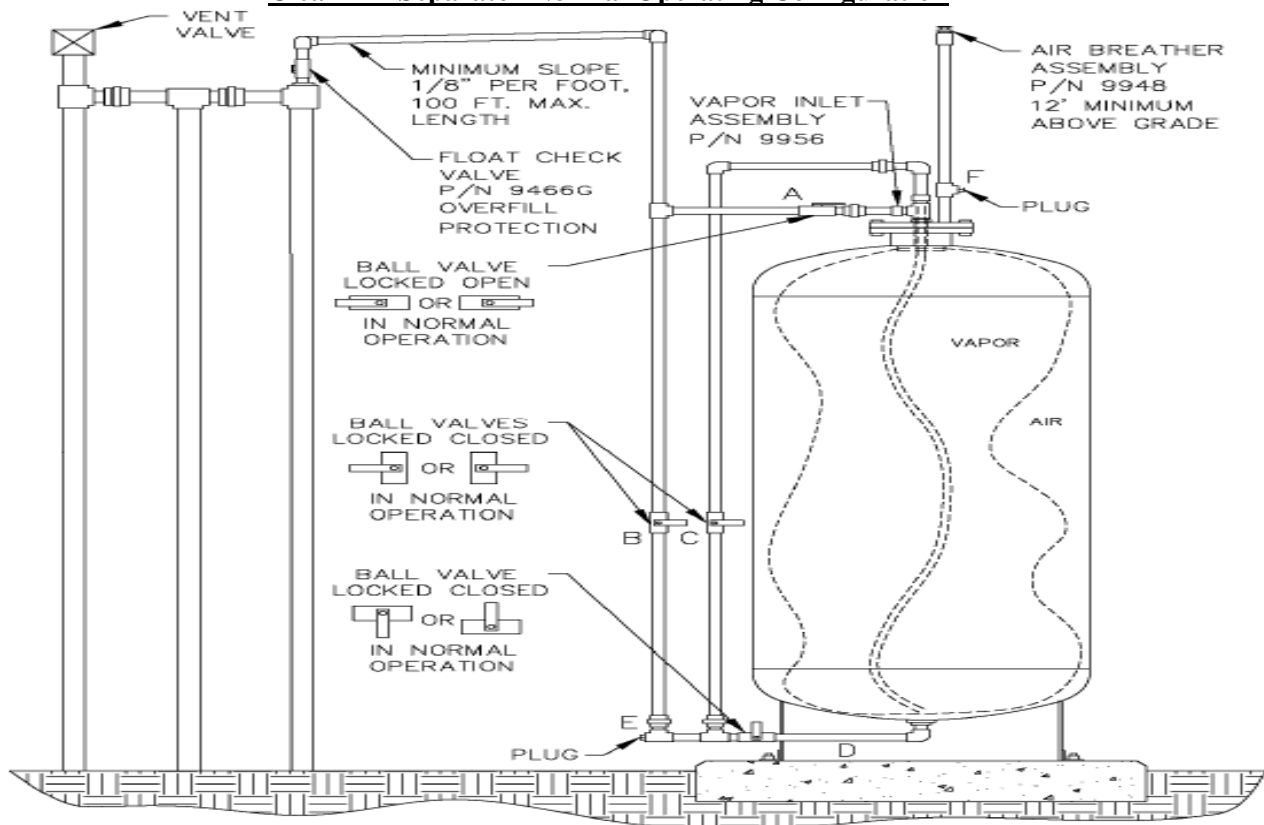

SAN DIEGO AIR POLLUTION CONTROL DISTRICT
COMPLIANCE DIVISION
10124 OLD GROVE ROAD
SAN DIEGO CA 92131
PHONE (858) 586-2650 FAX (858) 586-2651

Verify that the Healy nozzle will not dispense fuel when the dispenser is authorized (ready to dispense fuel) and the boot is in a free state (uncompressed). To conduct this inspection, remove the nozzle from the dispenser, authorize the dispenser, and point the nozzle into an approved container (do not compress the mini-boot in any manner) and actuate the nozzle lever. No fuel should dispense. Any nozzle that dispenses fuel with the miniboot in a free state condition, as determined by this inspection procedure, shall be removed from service until repaired or replaced.

Nozzle #	Pass/Fail

Nozzle #	Pass/Fail

VP 1000 Vacuum Pump Inspection

Do the VP1000 vacuum pumps have loose or damaged vapor line connections? ☐ YES ☐ NO
 (If copper tubing is kinked or loose remove the dispenser from service and call a Healy certified Technician for service)